

Foxboro™ DCS

Compact FBM241/c/d Discrete I/O Modules

PSS 41H-2C241

Product Specification

December 2022









Legal Information

The Schneider Electric brand and any trademarks of Schneider Electric SE and its subsidiaries referred to in this guide are the property of Schneider Electric SE or its subsidiaries. All other brands may be trademarks of their respective owners.

This guide and its content are protected under applicable copyright laws and furnished for informational use only. No part of this guide may be reproduced or transmitted in any form or by any means (electronic, mechanical, photocopying, recording, or otherwise), for any purpose, without the prior written permission of Schneider Electric.

Schneider Electric does not grant any right or license for commercial use of the guide or its content, except for a non-exclusive and personal license to consult it on an "as is" basis. Schneider Electric products and equipment should be installed, operated, serviced, and maintained only by qualified personnel.

As standards, specifications, and designs change from time to time, information contained in this guide may be subject to change without notice.

To the extent permitted by applicable law, no responsibility or liability is assumed by Schneider Electric and its subsidiaries for any errors or omissions in the informational content of this material or consequences arising out of or resulting from the use of the information contained herein.

Overview

The Compact FBM241, FBM241c, and FBM241d each have eight discrete inputs and eight discrete outputs.

The Compact Channel Isolated, Discrete I/O Interface Modules (Compact FBM241/c/d) have eight discrete input channels and eight discrete output channels. Associated termination assemblies (TAs) support discrete input or output signals at voltages of under 60 VDC, 120 VAC/125 VDC, or 240 VAC.

Depending on the type of I/O signal required, the TAs contain current limiting devices, fuses, relays, or relay outputs with internal or external power source and fusing.

The module is available in three distinct types and each type with its associated TA supports the following discrete inputs and outputs:

Туре	Inputs	Outputs
Compact FBM241	15 to 60 VDC, 125 VDC, 120 VAC, or 240 VAC Switch (external or internal power source)	15 to 60 VDC at 2 A, or 30 VDC at 5 A, or 125 VDC at 0.5 A, or 120 VAC at 5 A, or 240 VAC at 5 A Switch (external power source)
Compact FBM241c	15 to 60 VDC Contact (unprotected -no fuse, or protected - fused)	15 to 60 VDC at 2 A, or 240 VAC at 5 A Switch (external power source)
FBM241d	15 to 60 VDC Contact	12 VDC at 12 mA Switch (internal power source)

Each type of Fieldbus Module (FBM), without signal conditioning, uses a 15 to 60 VDC input or output signal. Each discrete input and output is galvanically isolated from other channels and ground. When used with external excitation, each discrete input and output is group isolated.

The module performs signal conversion required to interface electrical input signals from field sensors to the optionally redundant fieldbus. It executes the Discrete I/O or Ladder Logic program, with the following configurable options: Input Filter Time, Fail Safe Configuration, Fail-Safe Fall-Back, and Sustained or Momentary Outputs. If the Momentary Output configuration is selected, then Pulse Output Interval is also configurable.

Features

- 8 discrete inputs
- 8 discrete outputs
- Supports discrete inputs/output signals at voltages of:
 - 15 to 60 VDC
 - 120 VAC/125 VDC
 - 240 VAC
- Each input and output is galvanically isolated: group isolated when used with external excitation
- Compact, rugged design suitable for enclosure in Class G3 (harsh) environments
- Executes the Discrete I/O or Ladder Logic program, with the following configurable options: Input Filter Time, Fail Safe Configuration, Fail-Safe Fall-Back, and Sustained or Momentary Outputs
- · Various Termination Assemblies (TAs) that contain:
 - Current limiting devices
 - Fuses
 - Relay outputs
 - Relay outputs with internal or external power source and fusing
 - Solid state outputs

Compact Design

The Compact FBM241's design is narrower than the standard 200 Series FBMs. It has a rugged Acrylonitrile Butadiene Styrene (ABS) exterior for physical protection of the circuits. Enclosures specially designed for mounting the FBMs provide various levels of environmental protection, up to harsh environments, per ISA Standard S71.04.

Visual Indicators

Light-emitting diodes (LEDs) incorporated into the front of the module provide visual indication of the Fieldbus Module operational status, as well as the discrete states of the individual input and output points.

Easy Removal/Replacement

The module mounts on a Compact 200 Series baseplate. Two screws on the FBM secure the module to the baseplate.

The module can be removed or replaced without removing field device termination cabling, power, or communication cabling.

Fieldbus Communication

A Fieldbus Communications Module or a Control Processor interfaces to the redundant 2 Mbps module Fieldbus used by the FBMs. The Compact FBM241/c/d accepts communication from either path (A or B) of the redundant 2 Mbps Fieldbus. If one path is unsuccessful or is switched at the system level, the module continues communication over the active path.

Modular Baseplate Mounting

The modules mount on a DIN rail mounted modular baseplate, which accommodates up to 16 compact FBMs. The baseplate is either DIN rail mounted or rack mounted, and includes signal connectors for redundant fieldbus, redundant independent DC power, and termination cables.

Security

Field power for contacts or solid state switches is current limited.

Termination Assemblies

Field I/O signals connect to the FBM subsystem via DIN rail mounted TAs. The TAs used with the Compact FBM241/c/d are described in Termination Assemblies And Cables, page 12.

Functional Specifications

Input/Output Channels	8 input and 8 output isolated channels
Filter or Debounce Time(a)	Configurable (No Filtering, 4, 8, 16, or 32 ms)
Voltage Monitor Function (Compact FBM241)	Input On-State Voltage: Off-State Voltage: Off-State Voltage: Off-State Voltage: Off-State Voltage: Off-State Voltage: Off-State: Off-State:
Contact Sensor Function (Compact FBM241c and FBM241d)	 Range (each channel): Contact open (off) or closed (on) Open-Circuit Voltage: 24 VDC ±15% Short-Circuit Current: 2.5 mA (nominal) On-State Resistance: 1.0 k Ω (maximum) Off-State Resistance: 100 k Ω (minimum)
Output Switch with External Source (Compact FBM241 and FBM241c)	 Applied Voltage: 60 VDC (maximum) Load Current: 2.0 A (maximum) Off-State Leakage Current: 0.1 mA (maximum)
Output Switch with Internal Source (FBM241d)	 Output Voltage (No Load): 12 VDC ±20% Source Resistance: 680 Ω (nominal) Shorted Output (On-State) Duration: Indefinite Off-State Leakage Current: 0.1 mA (maximum)
Inductive Loads	Output may require a protective diode or metal oxide varistor (MOV) connected across the inductive load.

voltages, as stated elsewhere in this specification, violates electrical safety codes and may expose users to electric shock. Failure to follow these instructions will result in death or serious injury.	Isolation	Each channel is galvanically isolated from all other channels and earth (ground). The module withstands, without damage, a potential of 600 VAC applied for one minute between any channel and ground, or between a given channel and any other channel. Channels are group isolated when used with external excitation. A DANGER HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH
Injury.		connection to voltages of these levels. Exceeding the limits for external voltages, as stated elsewhere in this specification, violates electrical
Power Requirements • Input Voltage Range (Redundant): 24 VDC +5%, -10% • Consumption (Maximum): 5 W • Heat Dissipation (Maximum): 6 W Loop Power Supply Protection Current limited to 2.5 mA for inputs. Resistor limited (680 Ω) for outputs internal power. Field Terminations Functional Specifications Calibration Requirements Calibration Requirements Calibration of the modules and TA is not required. European EMC Directive 2004/108/EC (Prior to April 20, 2016) and 201-30/EU (Beginning April 20, 2016) Meets: EN61326-1:2013 Class A Emissions and Industrial Immunity Lev. Regulatory Compliance, Product Safety • Underwriters Laboratories (UL) for U.S. and Canada UL/UL-C listed as suitable for use in UL/UL-C listed Class I, Groups D; Division 2; temperature code T4 enclosure based systems when connected to specified Foxboro M DCS processor modules as described in the Standard and Compact 200 Series Subsystem Use Guide (B0400FA). Communications circuits also meet the requirement for Class 2 as defined in Article 725 of the National Electrical Code (INFPA No.70) and Section 16 of the Canadian Electrical Code (INFPA No.70) and Section 16 of the Canadian Electrical Code (INFPA No.70) and Section 16 of the Canadian Electrical Code (INFPA No.70) and Section 16 of the Canadian Electrical Code (INFPA No.70) and Section 16 of the Canadian Electrical Code (INFPA No.70) and Section 16 of the Canadian Electrical Code (INFPA No.70) and Section 16 of the Canadian Electrical Code (INFPA No.70) and Section 16 of the Canadian Electrical Code (INFPA No.70) and Section 16 of the Canadian Electrical Code (INFPA No.70) and Section 16 of the Canadian Electrical Code (INFPA No.70) and Section 16 of the Canadian Electrical Code (INFPA No.70) and Section 16 of the Canadian Electrical Code (INFPA No.70) and Section 16 of the Canadian Electrical Code (INFPA No.70) and Section 16 of the Canadian Electrical Code (INFPA No.70) and Section 16 of the Canadian Electrical Code (INFPA No.70) and Section 16 of the Canadian Electrical Code (INFP		
24 VDC +5%, -10% Consumption (Maximum): 5 W Heat Dissipation (Maximum): 6 W Current limited to 2.5 mA for inputs. Resistor limited (680 Ω) for outputs internal power. Field Terminations Functional Specifications Calibration Requirements Calibration Requirements Calibration Requirements Calibration Of the modules and TA is not required. European EMC Directive 2004/108/EC (Prior to April 20, 2016) and 201-30/EU (Beginning April 20, 2016) Meets: EN61326-1:2013 Class A Emissions and Industrial Immunity Lev. *Underwriters Laboratories (UL) for U.S. and Canada UL/UL-C listed as suitable for use in UL/UL-C listed Class I, Groups D; Division 2; temperature code T4 enclosure based systems when connected to specified Foxboro™ DCS processor modules as described in the Standard and Compact 200 Series Subsystem Use Guide (B0400FA). *Underwriters Laboratories (UL) for U.S. and Canadia Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electri	Communication	Communicates with its associated FCM or FCP via the redundant 2 Mbps HDLC module Fieldbus
Consumption (Maximum): 5 W Heat Dissipation (Maximum): 6 W Current limited to 2.5 mA for inputs. Resistor limited (680 Ω) for outputs vinternal power. See General Purpose Plug-In Relay Termination Assembly Specification page 24)" Calibration Requirements Calibration of the modules and TA is not required. European EMC Directive 2004/108/EC (Prior to April 20, 2016) and 2014 30/EU (Beginning April 20, 2016) Meets: EN61326-1:2013 Class A Emissions and Industrial Immunity Lev Underwriters Laboratories (UL) for U.S. and Canada UL/UL-C listed as suitable for use in UL/UL-C listed Class I, Groups D; Division 2; temperature code T4 enclosure based systems when connected to specified Foxboro "M DCS processor modules as described in the Standard and Compact 200 Series Subsystem Use Guide (B0400FA). Communications circuits also meet the requirem for Class 2 as defined in Article 725 of the National Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (CSC C22.1). Conditions for use are as specified in the Standard and Compact 200 Series Subsystem Use Guide (B0400FA). European Low Voltage Directive 2006/95/EC (Prior to April 20, 2016) and 2014/34/EU (Beginning April 20, 2016) and Explosive Atmospheres (ATEX) directive 94/9/EC (Prior to April 20, 2016) and 2014/34/EU (Beginning April 20, 2016) and 2014/34/EU (Beginning April 20, 2016) DEMKO certified as Ex nA IIC T4 for use in certified Zone 2 enclosus when connected to specified I/A Series processor modules as described in the Standard and Compact 200 Series Subsystem Use Guide (B0400FA). RoHS Compliance Complies with European RoHS Directive 2011/65/EU, including amendir	Power Requirements	Input Voltage Range (Redundant):
5 W Heat Dissipation (Maximum): 6 W Current limited to 2.5 mA for inputs. Resistor limited (680 Ω) for outputs vinternal power. Field Terminations Functional Specifications Calibration Requirements Calibration Requirements Calibration of the modules and TA is not required. European EMC Directive 2004/108/EC (Prior to April 20, 2016) and 201-30/EU (Beginning April 20, 2016) Meets: EN61326-1:2013 Class A Emissions and Industrial Immunity Lev. Product Safety - Underwriters Laboratories (UL) for U.S. and Canada UL/UL-C listed as suitable for use in UL/UL-C listed Class I, Groups D; Division 2; temperature code T4 enclosure based systems when connected to specified in the Standard and Compact 200 Series Subsystem Use Guide (B0400FA). Communications circuits also meet the requirem for Class 2 as defined in Article 725 of the National Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Can		24 VDC +5%, -10%
Pleat Dissipation (Maximum): 6 W Loop Power Supply Protection Current limited to 2.5 mA for inputs. Resistor limited (680 Ω) for outputs of internal power. Field Terminations Functional Specifications Calibration Requirements Calibration of the modules and TA is not required. Regulatory Compliance, Electromagnetic Compatibility (EMC) Regulatory Compliance, Product Safety **Compliance, Product Safety** **Compliance, Product		Consumption (Maximum):
Loop Power Supply Protection Current limited to 2.5 mA for inputs. Resistor limited (680 Ω) for outputs of internal power. Field Terminations Functional Specifications Calibration Requirements Regulatory Compliance, Electromagnetic Compatibility (EMC) Regulatory Compliance, Product Safety Calibration Requirements Regulatory Compliance, Electromagnetic Compatibility (EMC) Regulatory Compliance, Product Safety Calibration Requirements Calibration of the modules and TA is not required. European EMC Directive 2004/108/EC (Prior to April 20, 2016) and 201-30/EU (Beginning April 20, 2016) Meets: EN61326-1:2013 Class A Emissions and Industrial Immunity Lev. Calibration of the modules and TA is not required. European EMC Directive 2004/108/EC (Prior to April 20, 2016) and 201-30/EU (Beginning April 20, 2016) and 201-30/EU (Beginning April 20, 2016) and 201-30/EU (Beginning April 20, 2016) and Explosive Atmospheres (ATEX) directive 94/9/EC (Prior to April 20, 2016) and 2014/35/EU (Beginning April 20, 2016) DEMKO certified as Ex nA IIC T4 for use in certified Zone 2 enclosus when connected to specified in the Standard and Compact 200 Series Subsystem User (Boduoper) and 2014/35/EU (Beginning April 20, 2016) and 2014/35/EU (Beginning April 20, 2016) DEMKO certified as Ex nA IIC T4 for use in certified Zone 2 enclosus when connected to specified in the Standard and Compact 200 Series Subsystem User (Boduoper) and 2014/35/EU (Beginning April 20, 2016) DEMKO certified as Ex nA IIC T4 for use in certified Zone 2 enclosus when connected to specified in the Standard and Compact 200 Series Subsystem User (Boduoper) and 2014/35/EU (Beginning April 20, 2016) Complies with European RoHS Directive 2011/65/EU, including amendir		5 W
Loop Power Supply Protection Current limited to 2.5 mA for inputs. Resistor limited (680 Ω) for outputs of internal power. See General Purpose Plug-In Relay Termination Assembly Specification page 24)" Calibration Requirements Calibration of the modules and TA is not required. Regulatory Compliance, Electromagnetic Compatibility (EMC) Regulatory Compliance, Product Safety - Underwriters Laboratories (UL) for U.S. and Canada UL/UL-C listed as suitable for use in UL/UL-C listed Class I, Groups D; Division 2; temperature code T4 enclosure based systems when connected to specified Foxboro™ DCS processor modules as described in the Standard and Compact 200 Series Subsystem Use Guide (80400FA). Communications circuits also meet the requirem for Class 2 as defined in Article 725 of the National Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (CSC C22.1). Conditions for use are as specified in the Standard and Compact 200 Series Subsystem User's Guide (B0400FA). - European Low Voltage Directive 2006/95/EC (Prior to April 20, 2016) and 2014/35/EU (Beginning April 20, 2016) and Explosive Atmospheres (ATEX) directive 94/9/EC (Prior to April 20, 2016) and 2014/34/EU (Beginning April 20, 2016) in the Standard and Compact 200 Series Subsystem User's Guide (B0400FA). RoHS Compliance Complies with European RoHS Directive 2011/65/EU, including amendir		Heat Dissipation (Maximum):
internal power. Field Terminations Functional Specifications Calibration Requirements Calibration of the modules and TA is not required. Regulatory Compliance, Electromagnetic Compatibility (EMC) Regulatory Compliance, Product Safety Calibration Requirements Calibration of the modules and TA is not required. European EMC Directive 2004/108/EC (Prior to April 20, 2016) and 201-30/EU (Beginning April 20, 2016) Meets: EN61326-1:2013 Class A Emissions and Industrial Immunity Lev Underwriters Laboratories (UL) for U.S. and Canada UL/UL-C listed as suitable for use in UL/UL-C listed Class I, Groups D; Division 2; temperature code T4 enclosure based systems when connected to specified Foxboro™ DCS processor modules as described in the Standard and Compact 200 Series Subsystem Use Guide (B0400FA). Communications circuits also meet the requirem for Class 2 as defined in Article 725 of the National Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (CS/C22.1). Conditions for use are as specified in the Standard and Compact 200 Series Subsystem User's Guide (B0400FA). • European Low Voltage Directive 2006/95/EC (Prior to April 20, 2016) and 2014/35/EU (Beginning April 20, 2016) and Explosive Atmospheres (ATEX) directive 94/9/EC (Prior to April 20, 2016) and 2014/34/EU (Beginning April 20, 2016) DEMKO certified as Ex nA IIC T4 for use in certified Zone 2 enclosu when connected to specified I/A Series processor modules as described in the Standard and Compact 200 Series Subsystem User Guide (B0400FA). RoHS Compliance Complies with European RoHS Directive 2011/65/EU, including amendir		6 W
Specifications page 24)" Calibration Requirements Calibration of the modules and TA is not required. Regulatory Compliance, Electromagnetic Compatibility (EMC) European EMC Directive 2004/108/EC (Prior to April 20, 2016) and 2014/30/EU (Beginning April 20, 2016) Regulatory Compliance, Product Safety • Underwriters Laboratories (UL) for U.S. and Canada UL/UL-C listed as suitable for use in UL/UL-C listed Class I, Groups D; Division 2; temperature code T4 enclosure based systems when connected to specified Foxboro™ DCS processor modules as described in the Standard and Compact 200 Series Subsystem Use Guide (B0400FA). Guide (B0400FA). European Low Voltage Directive 2006/95/EC (Prior to April 20, 2016) and Compact 200 Series Subsystem User's Guide (B0400FA). • European Low Voltage Directive 2006/95/EC (Prior to April 20, 2016) and 2014/35/EU (Beginning April 20, 2016) and Explosive Atmospheres (ATEX) directive 94/9/EC (Prior to April 20, 2016) and 2014/34/EU (Beginning April 20, 2016) DEMKO certified as Ex nA IIC T4 for use in certified Zone 2 enclosu when connected to specified I/A Series processor modules as described in the Standard and Compact 200 Series Subsystem Use Guide (B0400FA). RoHS Compliance Complies with European RoHS Directive 2011/65/EU, including amendir	Loop Power Supply Protection	Current limited to 2.5 mA for inputs. Resistor limited (680 $\Omega)$ for outputs with internal power.
European EMC Directive 2004/108/EC (Prior to April 20, 2016) and 2014 30/EU (Beginning April 20, 2016) Meets: EN61326-1:2013 Class A Emissions and Industrial Immunity Lev Product Safety • Underwriters Laboratories (UL) for U.S. and Canada UL/UL-C listed as suitable for use in UL/UL-C listed Class I, Groups D; Division 2; temperature code T4 enclosure based systems when connected to specified Foxboro™ DCS processor modules as described in the Standard and Compact 200 Series Subsystem Use Guide (B0400FA). Communications circuits also meet the requirem for Class 2 as defined in Article 725 of the National Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (CSA C22.1). Conditions for use are as specified in the Standard and Compact 200 Series Subsystem User's Guide (B0400FA). • European Low Voltage Directive 2006/95/EC (Prior to April 20, 2016) and 2014/35/EU (Beginning April 20, 2016) and Explosive Atmospheres (ATEX) directive 94/9/EC (Prior to April 20, 2016) and 2014/34/EU (Beginning April 20, 2016) DEMKO certified as Ex nA IIC T4 for use in certified Zone 2 enclosu when connected to specified I/A Series processor modules as described in the Standard and Compact 200 Series Subsystem Use Guide (B0400FA). RoHS Compliance Complies with European RoHS Directive 2011/65/EU, including amendir		See General Purpose Plug-In Relay Termination Assembly Specifications, page 24)"
Electromagnetic Compatibility (EMC) Meets: EN61326-1:2013 Class A Emissions and Industrial Immunity Lev Pegulatory Compliance, Product Safety • Underwriters Laboratories (UL) for U.S. and Canada UL/UL-C listed as suitable for use in UL/UL-C listed Class I, Groups D; Division 2; temperature code T4 enclosure based systems when connected to specified Foxboro™ DCS processor modules as described in the Standard and Compact 200 Series Subsystem Use Guide (B0400FA). Communications circuits also meet the requirem for Class 2 as defined in Article 725 of the National Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (SA C22.1). Conditions for use are as specified in the Standard and Compact 200 Series Subsystem User's Guide (B0400FA). • European Low Voltage Directive 2006/95/EC (Prior to April 20, 2016) and 2014/35/EU (Beginning April 20, 2016) and Explosive Atmospheres (ATEX) directive 94/9/EC (Prior to April 20, 2016) and 2014/34/EU (Beginning April 20, 2016) DEMKO certified as Ex nA IIC T4 for use in certified Zone 2 enclosus when connected to specified I/A Series processor modules as described in the Standard and Compact 200 Series Subsystem User Guide (B0400FA). RoHS Compliance Complies with European RoHS Directive 2011/65/EU, including amending the Standard Science (Both) and Compact 2011/65/EU, including amending the Standard Science (Both) and Compact 2011/65/EU, including amending the Standard Science (Both) and Compact 2011/65/EU, including amending the Standard Science (Both) and Compact 2011/65/EU, including amending the Standard Science (Both) and Compact 2011/65/EU, including amending the Standard Science (Both) and Compact 2011/65/EU, including amending the Standard Science (Both) and Compact 2011/65/EU, including amending the Standard Science (Both) and Compact 2011/65/EU, including amending the Standard Science (Both) and Compact 2011/65/EU, includin	Calibration Requirements	Calibration of the modules and TA is not required.
 Meets: EN61326-1:2013 Class A Emissions and Industrial Immunity Lev Regulatory Compliance, Product Underwriters Laboratories (UL) for U.S. and Canada UL/UL-C listed as suitable for use in UL/UL-C listed Class I, Groups D; Division 2; temperature code T4 enclosure based systems when connected to specified Foxboro™ DCS processor modules as described in the Standard and Compact 200 Series Subsystem Use Guide (B0400FA). Communications circuits also meet the requirement for Class 2 as defined in Article 725 of the National Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (CSA C22.1). Conditions for use are as specified in the Standard and Compact 200 Series Subsystem User's Guide (B0400FA). European Low Voltage Directive 2006/95/EC (Prior to April 20, 2016 and 2014/35/EU (Beginning April 20, 2016) and Explosive Atmospheres (ATEX) directive 94/9/EC (Prior to April 20, 2016) and 2014/34/EU (Beginning April 20, 2016) DEMKO certified as Ex nA IIC T4 for use in certified Zone 2 enclosus when connected to specified I/A Series processor modules as described in the Standard and Compact 200 Series Subsystem Use Guide (B0400FA). RoHS Compliance Complies with European RoHS Directive 2011/65/EU, including amendir 	Electromagnetic Compatibility	European EMC Directive 2004/108/EC (Prior to April 20, 2016) and 2014/30/EU (Beginning April 20, 2016)
UL/UL-C listed as suitable for use in UL/UL-C listed Class I, Groups D; Division 2; temperature code T4 enclosure based systems when connected to specified Foxboro™ DCS processor modules as described in the Standard and Compact 200 Series Subsystem Use Guide (B0400FA). Communications circuits also meet the requirement for Class 2 as defined in Article 725 of the National Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (CSA C22.1). Conditions for use are as specified in the Standard and Compact 200 Series Subsystem User's Guide (B0400FA). ■ European Low Voltage Directive 2006/95/EC (Prior to April 20, 2016) and 2014/35/EU (Beginning April 20, 2016) and Explosive Atmospheres (ATEX) directive 94/9/EC (Prior to April 20, 2016) and 2014/34/EU (Beginning April 20, 2016) DEMKO certified as Ex nA IIC T4 for use in certified Zone 2 enclosus when connected to specified I/A Series processor modules as described in the Standard and Compact 200 Series Subsystem Use Guide (B0400FA). RoHS Compliance Complies with European RoHS Directive 2011/65/EU, including amendir	(EIVIC)	Meets: EN61326-1:2013 Class A Emissions and Industrial Immunity Levels
D; Division 2; temperature code T4 enclosure based systems when connected to specified Foxboro™ DCS processor modules as described in the <i>Standard and Compact 200 Series Subsystem Use Guide</i> (B0400FA). Communications circuits also meet the requirem for Class 2 as defined in Article 725 of the National Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (CSA C22.1). Conditions for use are as specified in the <i>Standard and Compact 200 Series Subsystem User's Guide</i> (B0400FA). • European Low Voltage Directive 2006/95/EC (Prior to April 20, 2016 and 2014/35/EU (Beginning April 20, 2016) and Explosive Atmospheres (ATEX) directive 94/9/EC (Prior to April 20, 2016) and 2014/34/EU (Beginning April 20, 2016) DEMKO certified as Ex nA IIC T4 for use in certified Zone 2 enclosus when connected to specified I/A Series processor modules as described in the <i>Standard and Compact 200 Series Subsystem Use Guide</i> (B0400FA). RoHS Compliance Complies with European RoHS Directive 2011/65/EU, including amendir		Underwriters Laboratories (UL) for U.S. and Canada
and 2014/35/EU (Beginning April 20, 2016) and Explosive Atmospheres (ATEX) directive 94/9/EC (Prior to April 20, 2016) and 2014/34/EU (Beginning April 20, 2016) DEMKO certified as Ex nA IIC T4 for use in certified Zone 2 enclosu when connected to specified I/A Series processor modules as described in the Standard and Compact 200 Series Subsystem Use Guide (B0400FA). RoHS Compliance Complies with European RoHS Directive 2011/65/EU, including amendir	Safety	connected to specified Foxboro™ DCS processor modules as described in the Standard and Compact 200 Series Subsystem User's Guide (B0400FA). Communications circuits also meet the requirements for Class 2 as defined in Article 725 of the National Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (CSA C22.1). Conditions for use are as specified in the Standard and
when connected to specified I/A Series processor modules as described in the <i>Standard and Compact 200 Series Subsystem Use Guide</i> (B0400FA). RoHS Compliance Complies with European RoHS Directive 2011/65/EU, including amending the complex of th		and 2014/35/EU (Beginning April 20, 2016) and Explosive Atmospheres (ATEX) directive 94/9/EC (Prior to April 20, 2016) and
RoHS Compliance Complies with European RoHS Directive 2011/65/EU, including amending		described in the Standard and Compact 200 Series Subsystem User's
Directives 2015/863 and 2017/2102.	RoHS Compliance	Complies with European RoHS Directive 2011/65/EU, including amending Directives 2015/863 and 2017/2102.

Marine Certification	ABS Type Approved and Bureau Veritas Marine certified for Environmental Category EC31.
(a) Digital filtering available for 200 Se firmware.	eries FBM or competitive migration modules with version 1.25H or later

Environmental Specifications

	Operating	Storage			
Temperature	 Compact FBM241/c: -20 to +60°C (-4 to +140°F) Termination Assembly - PA: -20 to +70°C (-4 to +158°F) 	-40 to +70°C (-40 to +158°F)			
Relative Humidity	5 to 95% (noncondensing)	5 to 95% (noncondensing)			
Altitude	-300 to +3,000 m (-1,000 to +10,000 ft)	-300 to +12,000 m (-1,000 to +40,000 ft)			
Contamination	Suitable for use in Class G3 (Harsh) environments on exposure testing according to EIA Standard 36	Harsh) environments as defined in ISA Standard S71.04, based g to EIA Standard 364-65, Class III.			
Vibration	0.75 g (5 to 500 Hz)				

NOTE: The environmental ranges can be extended by the type of enclosure containing the module. See the Product Specification Sheet (PSS) applicable to the enclosure that is to be used.

Physical Specifications

	Compact FBM241/241C/241D	Termination Assembly
Mounting	The Compact FBM241/241c/241d mounts on a Compact 200 Series 16-slot horizontal baseplate. The baseplate can be mounted on a horizontal DIN rail, or horizontally on a 19-inch rack using a mounting kit.	The TA mounts on a DIN rail and accommodates multiple DIN rail styles including 32 mm (1.26 in) and 35 mm (1.38 in)
	See Compact 200 Series 16-Slot Horizontal Baseplate (PSS 41H-2C200) for details.	
Weight	185 g (6.5 oz) approximate	 Compression: 127 mm (5.02 in) – 272 g (0.60 lb, approximate) 181 mm (7.13 in) – 300 g (0.70 lb, approximate) Ring Lug or Knife Switch: 181 mm (7.13 in) – 363 g (0.80 lb, approximate) 198 mm (7.78 in) – 400 g (0.90 lb, approximate) 251 mm (9.88 in) – 454 g (1.0 lb)
		 251 mm (9.88 in) – 454 g (1.0 lb, approximate) 286 mm (11.25 in) – 908 g (2.0 lb, approximate)
Dimensions	 Height: 130 mm (5.12 in) Width: 25 mm (0.98 in) Depth: 150 mm (5.9 in) - Including baseplate connectors, 139 mm (5.46 in) 	 Compression Screw: See Figure 1 and Figure 2 Knife Switch: See Figure 3
Part Numbers	 Compact FBM241: RH101DH Compact FBM241c: RH101DJ Compact FBM241d: RH101GL 	See Functional Specifications - Termination Assemblies, page 14
Termination Cables	 Cable Lengths: Up to 30 m (98 ft) Cable Materials: Polyurethane or Low Smoke Zero Haloge Termination Cable Type: Type 4 or type 4H - See Table 2, page 20 	

Cable Connection					
	FBM Baseplate End:				
	37-pin D-subminiature				
	Termination Assembly End:				
	37-pin D-subminiature				
Construction -	Material:				
Termination Assembly	Polyamide (PA), compression				
Assembly	Terminal Blocks:				
	Inputs - 2 tiers, 8 positions				
	Outputs- 2 tiers, 8 positions or 3 tiers, 8 positions				
	Excitation - 2 tiers, 2 positions				
	Power Distribution - 2 tiers, 2 positions				
Field Termination	Compression — Accepted Wiring Sizes:				
Connections	Solid/Stranded/AWG				
	0.2 to 4 mm ² /0.2 to 2.5 mm ² /24 to 12 AWG				
	Stranded with Ferrules				
	0.2 to 2.5 mm ² with or without plastic collar				
	Ring-Lug — Accepted Wiring Sizes:				
	#6 size connectors (0.375 in (9.5 mm))				
	0.5 to 4 mm ² /22 AWG to 12 AWG				
Termination	Electrical Service Life:				
Assembly Switching Relays	100,000 operations at rated resistive load 5,000,000 operations at no load				
Telays	5 A Relay:				
	• Type:				
	Single-Pole, Double-Throw, Normally Open (SPDT_NO)				
	Switching Current:				
	5 A at up to 120 VAC (see General Purpose Plug-In Relay Termination Assembly Specifications, page 24)				

Termination Assemblies and Cables

Field I/O signals connect to the FBM subsystem via DIN rail mounted termination assemblies (TAs). Multiple types of TAs are available with FBMs to provide I/O signal connections, signal conditioning, optical isolation from signal surges, external power connections, and/or fusing for protection of the FBM and/or field device as required by the particular FBM. Since these features are built into the termination assemblies (where required), in most applications there is no need for additional termination equipment for field circuit functions such as circuit protection or signal conditioning (including fusing and power distribution).

The DIN rail mounted termination assemblies connect to the Compact FBM baseplate by means of removable termination cables. The cables are available in a variety of lengths, up to 30 meters (98 feet), allowing the termination assemblies to be mounted as needed by plant design. See Functional Specifications - Termination Assemblies, page 14 for termination cable part numbers and specifications.

Discrete Inputs

Termination assemblies with discrete inputs support eight 2-wire discrete input signals at passive low voltage levels of less than 60 VDC and active high voltage levels of 125 VDC, 120 VAC, or 240 VAC. Active termination assemblies support input signal conditioning for FBMs. To condition signals, these termination assemblies can provide optical isolation, current limiting, noise reduction, voltage attenuation, or optional terminal blocks to connect externally supplied excitation voltage.

Low Voltage Discrete Inputs

The low voltage inputs (less than 60 VDC) use passive termination assemblies. Inputs can either be voltage monitor, switched or contact sense types. Voltage monitor inputs require an external field voltage source. Contact sense input use the FBM auxiliary +24 VDC power supply to wet field contacts.

A load may not be required for proper operation of the input channels. A diode may be required for a DC inductive load only.

High Voltage Discrete Inputs

The high voltage input circuits support 125 VDC, 120 VAC, or 240 VAC. Inputs can be either voltage monitor or switched types. Voltage monitor inputs require a field voltage source. Switch inputs use customer supplied excitation voltage applied to dedicated terminals on the termination assembly and distributed on the termination assembly to each of the input channels.

These circuits are located on daughter boards that are mounted under the component covers of the termination assemblies.

Discrete Outputs

Termination assemblies with discrete outputs support eight 2-wire discrete output signals at passive low voltages of less than 60 VDC and active high voltage levels of 120 VAC or 240 VAC. Active termination assemblies support output signal conditioning for FBMs. To condition signals, these termination assemblies provide fuse protection, relays, solid-state devices, and terminal blocks to connect externally supplied optional power distribution.

Low Voltage Discrete Outputs

The low voltage outputs (less than 60 VDC) use passive termination assemblies. These assemblies are available with and without output protection (fusing). Termination assemblies with protection have individual user serviceable fuses that are designed to limit the output current to 2 A. Eight vertically mounted, one per channel, 3.15 A sand filled fuses (temperature derated) allow a maximum of 2 A current per output channel. Termination assemblies without fusing (unprotected) are intended for use by Foxboro engineers or customers who are using interposing relays or fuse terminal blocks between the termination assembly and the field devices.

Power for the low voltage outputs can be supplied by the FBM +24 VDC auxiliary power supply (internally (FBM) sourced) or by a field voltage source (externally sourced).

High Voltage Discrete Outputs

The high voltage output (120 VAC or 240 VAC) termination assemblies use plug-in SPDT (Form C) electromechanical relays and solid-state switches. The plug-in sockets allow field replacement of individual relays. The relays and associated sockets are located under the component covers of the termination assemblies. The termination assembly's switched outputs use unsealed, general purpose relays. These assemblies are capable of providing mixed voltage and are designed to provide signal segregation by locating the low voltage inputs and the opposite side of the terminal assembly from the outputs. A solid-state output module is optionally available. High voltage discrete outputs are always externally sourced power.

The output termination assemblies come in either output or output with power distribution (user-supplied via terminals on the termination assembly). In both configurations, when the FBM output is on, the relay coil is energized and the relay contact is switched from normally closed (NC) position to the normally open (NO) position. The FBM +24 VDC auxiliary power supply is used to energize the relay coil.

Termination assemblies with power distribution have a dedicated terminal block which provides a connection to externally supplied power and distributed internally on the termination assembly to each of the output channels. The line or positive side of the supply is fused; the neutral or negative side of the supply is connected to the field.

The termination assembly has a pair of external excitation voltage terminals, which distribute customer-supplied wetting voltage to all input channels on the assembly. These terminals allow the field power to be daisy chained between terminal assemblies.

Functional Specifications - Termination Assemblies

Compact FBM Type	Input Signal	Output Signal ^(a)	TA Part Number ^(b)	Term. Type ^(c)	TA Cable Type ^(d)	TA Cert. Type ^(e)
			PA			
Compact FBM241	8 channel, voltage monitor 15 to 60 VDC Compact FBM241 channel isolation	8 channel, switch (externally sourced) <60 VDC at 2 A maximum, unprotected -no fuse Compact FBM241 channel isolation	RH916UY	С	4, 4H	1, 2
Compact	8 channel, voltage	8 channel, switch	RH916AQ	С	4, 4H	1, 2
FBM241	monitor 15 to 60 VDC	(externally sourced) 15 to 60 VDC at 2 A	RH916AR	RL		
	Compact FBM241 channel isolation	maximum (protected - fused) Compact FBM241 channel isolation				
Compact FBM241	8 channel, voltage monitor 15 to 60	8 channel, switch (externally sourced)	RH916QE	С	4	3
		SPDT (Form C) Relays <30 VDC at 5 A maximum				
		Up to 250 VAC at 5 A maximum				
		Total current for all 8 channels simultaneously is 12 A maximum				
		Channel Isolation provided by termination assembly				
Compact FBM241	8 channel, contact sense 125 VAC or	8 channel, switch (externally sourced)	RH916QV	С	4	5
	125 VDC with external excitation	SPDT (Form C) Relays <30 VDC at 5				
	Logic Zero 0 to 20 VAC; 0 to 20 VDC	A maximum Up to 250 VAC at 5 A				
	Logic One 80 to 132	maximum				
	VAC; 75 to 150 VDC Input Current for Logic One; 2 mA (typical)	Total current for all 8 channels				
		simultaneously is 12 A maximum				
	Group isolation provided by termination	Group isolation provided by				
	assembly	termination assembly				

Compact FBM Type	Input Signal	Output Signal ^(a)	TA Part Number ^(b)	Term. Type ^(c)	TA Cable Type(d)	TA Cert. Type ^(e)
			PA			
Compact FBM241	8 channel, voltage monitor 125 VAC or 125 VDC	8 channel, switch (externally sourced)	RH916YH	С	4	5
	Logic Zero 0 to 20 VAC; 0 to 20 VDC	SPDT (Form C) Relays <30 VDC at 5 A maximum				
	Logic One 80 to 132 VAC; 75 to 150 VDC	Up to 250 VAC at 5 A maximum				
	Input Current for Logic One; 2 mA (typical)	Total current for all 8 channels simultaneously is 12 A maximum				
	Channel isolation provided by termination assembly	Channel isolation provided by termination assembly				
Compact FBM241	8 channel, voltage monitor 125 VAC or 125 VDC	8 channel, switch (externally sourced)	RH916QG	С	4	5
	Logic Zero 0 to 20 VAC; 0 to 20 VDC	SPDT (Form C) Relays <30 VDC at 5 A maximum				
	Logic One 80 to 132 VAC; 75 to 150 VDC	Up to 250 VAC at 5 A maximum				
	Input Current for Logic One; 2 mA (typical)	Total current for all 8 channels simultaneously is 12 A maximum				
	Channel isolation provided by termination assembly	Group isolation provided by termination assembly				
Compact FBM241	8 channel, voltage monitor 125 VAC or 125 VDC with external excitation	8 channel, switch (externally sourced) SPDT (Form C) Relays <30 VDC at 5	RH916QT	С	4	5
	Logic Zero 0 to 20 VAC; 0 to 20 VDC	A maximum Up to 250 VAC at 5 A				
	Logic One 80 to 132 VAC; 75 to 150 VDC	maximum Total current for all 8				
	Input Current for Logic One; 2 mA (typical)	channels simultaneously is 12 A maximum				
	Group isolation provided by termination assembly	Channel isolation provided by termination assembly				

Compact FBM Type	Input Signal	Output Signal ^(a)	TA Part Number ^(b)	Term. Type ^(c)	TA Cable Type ^(d)	TA Cert. Type ^(e)
			PA	1		
Compact FBM241	8 channel, voltage monitor 120 VAC or 125 VDC with external excitation Logic Zero 0 to 20 VAC; 0 to 20 VDC Logic One 80 to 132 VAC; 75 to 150 VDC Input Current for Logic One; 2 mA (typical) Channel isolation provided by termination assembly	8 channel, switch (externally sourced) Solid State Switch 125 VAC/125 VDC at 2 A maximum Total current for all 8 channels simultaneously is 12 A maximum Channel isolation provided by termination assembly	RH917MX	C/ Knife	4	5
Compact FBM241	8 channel, voltage monitor 120 VAC or 125 VDC with external excitation Logic Zero 0 to 20 VAC; 0 to 20 VDC Logic One 80 to 132 VAC; 75 to 150 VDC Input Current for Logic One; 2 mA (typical) Channel isolation provided by termination assembly	8 channel, switch (externally sourced) SPDT (Form C) Relays <30 VDC at 5 A maximum Up to 250 VAC at 2 A maximum Total current for all 8 channels simultaneously is 12 A maximum Channel isolation provided by termination assembly relay P0165CL. The max current rating is 2 A due to a fuse in each channel	RH926DS	Knife	4	5
Compact FBM241	8 channel, contact sense 240 VAC with external excitation Logic Zero 0 to 40 VAC Logic One 160 to 280 VAC Input Current for Logic One; 1.6 mA maximum Group isolation provided by termination assembly	8 channel, switch (externally sourced) SPDT (Form C) Relays <30 VDC at 5 A maximum Up to 250 VAC at 5 A maximum Total current for all 8 channels simultaneously is 12 A maximum Channel isolation provided by termination assembly relay P0165CL	RH916QX	С	4	5

Compact FBM Type	Input Signal	Output Signal ^(a)	TA Part Number ^(b)	Term. Type ^(c)	TA Cable Type ^(d)	TA Cert. Type ^(e)
			PA			
Compact FBM241	8 channel, contact sense 240 VAC with external excitation	Externally sourced with power distribution	RH916QZ	С	4	5
	Logic Zero 0 to 40 VAC	SPDT (Form C) Relays <30 VDC at 5 A maximum				
	Logic One 160 to 280 VAC	Up to 250 VAC at 5 A maximum				
	Input Current for Logic One; 1.6 mA maximum	Total current for all 8 channels simultaneously is 12 A maximum				
	Group isolation provided by termination assembly	Group isolation provided by termination assembly				
Compact FBM241	8 channel, voltage monitor 240 VAC	8 channel, switch (externally sourced)	RH916QJ	С	4	5
	Logic Zero 0 to 40 VAC Logic One 160 to 280 VAC Input Current for Logic One; 1.6 mA maximum Channel isolation provided by	SPDT (Form C) Relays <30 VDC at 5 A maximum				
		Up to 250 VAC at 5 A				
		Total current for all 8 channels				
		simultaneously is 12 A maximum				
	termination assembly	Channel isolation provided by termination assembly				
Compact FBM241	8 channel, voltage monitor 240 VAC	8 channel, switch (externally sourced)	RH916QL	С	4	5
	Logic Zero 0 to 40 VAC	with power distribution SPDT (Form C)				
	Logic One 160 to 280 VAC	Relays <30 VDC at 5 A maximum				
	Input Current for Logic One; 1.6 mA	Up to 250 VAC at 5 A maximum				
	maximum Channel isolation provided by termination	Total current for all 8 channels				
		simultaneously is 12 A maximum				
	assembly	Group isolation provided by termination assembly				

Compact FBM Type	Input Signal	Output Signal ^(a)	TA Part Number ^(b)	Term. Type ^(c)	TA Cable Type ^(d)	TA Cert. Type ^(e)
			PA			
Compact FBM241c	8 channel, contact sense 24 VDC contact wetting from Compact FBM241c Channel isolation	8 channel, switch (externally sourced) 15 to 60 VDC at 2 A maximum, protected - fused	RH916JW	С	4	1, 2
		Compact FBM241c channel isolation				
Compact FBM241c	8 channel, contact sense 24 VDC contact wetting from Compact FBM241c Channel isolation	8 channel, switch (externally sourced) <60 VDC at 2 A maximum, unprotected - no fuse	RH916UD	С	4, 4H	1, 2
		Compact FBM241c channel isolation				
Compact FBM241c	8 channel, contact sense 24 VDC contact wetting from Compact FBM241c Channel isolation	8 channel, switch (externally sourced)	RH916AW	С	4	3
		SPDT (Form C) Relays <30 VDC at 5 A maximum				
		Up to 250 VAC at 5 A maximum				
		Total current for all 8 channels simultaneously is 12 A maximum				
		Channel isolation provided by termination assembly				
Compact FBM241c	8 channel, contact sense 24 VDC	8 channel, switch (externally sourced)	RH916QQ	С	4	1, 2
	contact wetting from Compact FBM241c Channel isolation	SPDT (Form C) Relays <30 VDC at 5 A maximum				
		Up to 250 VAC at 5 A maximum				
		Total current for all 8 channels simultaneously is 12 A maximum				
		Group isolation provided by termination assembly				

Compact FBM Type	Input Signal	Output Signal ^(a)	TA Part Number ^(b)	Term. Type ^(c)	TA Cable Type ^(d)	TA Cert. Type ^(e)
			PA			
Compact FBM241d	8 channel, contact sense 24 VDC contact wetting from FBM241d channel isolation	8 channel, switch (internally sourced) 12 VDC at 15 mA maximum FBM241d channel isolation	RH916YW	С	4	1, 2

(a) Output inductive load limits based on current of 2 A. Inductance limit increases by a factor of 4, for each factor of 2 reduction in current. For an inductive load above stated limits, a snubber diode is required for a dc inductive load or a MOV (metal oxide varistor) is required for an ac inductive load. Diode current rating must be equal to the maximum load current and voltage rating equal to 1.3X maximum supply voltage. MOV must be rated for 120 VAC use and current rating must be equal to maximum load current.

- (b) PA (polyamide) termination assemblies rated from -20 to +70°C (-4 to +158°F).
- (c) C = TA with compression terminals, RL = TA with ring lug terminals. Knife has compression terminals.
- (d) See Table 2, page 20 for cable part numbers and specifications.
- (e) See Table 1, page 19 for Termination Assembly certification definitions.

NOTE: For 120 VAC / 240 VAC input channel applications, a maximum cable length of 61 m (200 ft) is recommended, in order to minimize customer plant stray physical capacitance, and coupling/ leakage current from possibly effecting channel currents. Additional details are provided in the *Standard and Compact 200 Series Subsystem User's Guide* (B0400FA).

Table 1 - Certifications for Termination Assemblies

Туре	Certification
Type 1	TAs are UL/UL-C listed as suitable for use in Class I; Groups A-D; Division 2 temperature code T4 hazardous locations. They are DEMKO certified Ex nA IIC T4 Gc for use in Zone 2 potentially explosive atmospheres.
Type 2	TAs are UL/UL-C listed for supplying field circuits Class I; Groups A-D; Division 2 hazardous locations when connected to specified 200 Series FBMs and field circuits meeting entity parameter constraints specified in <i>Standard and Compact 200 Series Subsystem User's Guide</i> (B0400FA). They are also DEMKO certified for supplying field circuits for Group IIC, Zone 2 potentially explosive atmospheres. Field circuits are also Class 2 limited energy (60 VDC, 30 VAC, 100 VA or less) if customer-supplied equipment meets Class 2.
Type 3	Same as Type 2 above except that only input circuits are non-incendive/Class 2.
Type 5	The TA and its field circuitry are for use in only ordinary (non-hazardous) locations.

Table 2 - Cable Types and Part Numbers

Length m (ft)	Type 4, 26 AWG ^(a) P/PVC	Type 4H, 22 AWG ^{(a)(b)} P/PVC	Type 4 LSZH(c)	Type 4H LSZH ^{(b)(c)}
0.5 (1.6)	RH100CJ	-	RH100BN	-
1.0 (3.2)	RH100CK	-	RH100BP	-
1.5 (4.9)	RH100EQ	-	RH100EN	-
2.0 (6.6)	RH100CL	-	RH100BQ	-
3.0 (9.8)	RH100CM	-	RH100BR	-
5.0 (16.4)	RH100CN	-	RH100BS	-
10.0 (32.8)	RH100CP	RH100CX	RH100BT	RH100DC
15.0 (49.2)	RH100CQ	RH100CY	RH100BU	RH100DD
20.0 (65.6)	RH100CR	RH100CZ	RH100BV	RH100DE
25.0 (82.0)	RH100CS	RH100DA	RH100BW	RH100DF
30.0 (98.4)	RH100CT	RH100DB	RH100BX	RH100DG

⁽a) P/PVC cable assembles polyurethane outer jacket and semi-rigid PVC primary conductor insulation temperature range: -20 to + 70°C (-4 to 158°F)


⁽b) Type 4H cables are used to reduce voltage drop in long (greater than 5 m (15 ft)) cable run applications


 $^{^{(}c)}$ Low smoke zero halogen or low smoke free of halogen (LSZH) is a material classification used for cable jacketing. LSZH is composed of thermoplastic or thermoset compounds that emit limited smoke and no halogen when exposed to high sources of heat. Temperature range: -40 to +105°C (-40 to +221°F).

Dimensions - Nominal


[mm]
in
Compression Termination Assemblies


RH916UY, RH916AQ, RH916JW, RH916YW, RH916UD

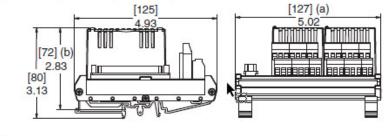


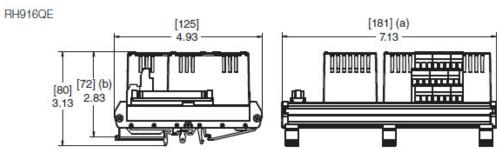



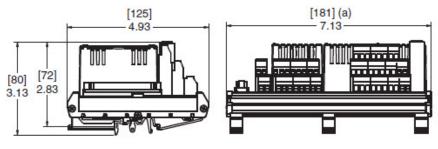






- (a) Overall width for determining DIN rail loading.
- (b) Height above DIN rail (add to DIN rail height for total)


NOTE: Dimensions for this polyamide termination assembly are smaller

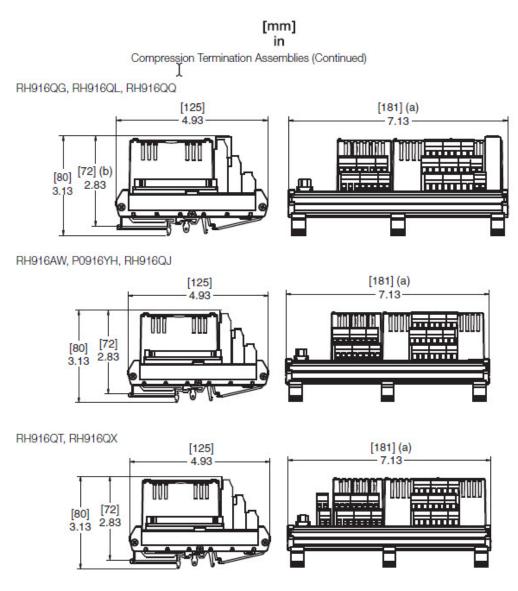

- (a) Overall width for determining DIN rail loading.
- (b) Height above DIN rail (add to DIN rail height for total)

NOTE: Dimensions for this polyamide termination assembly are smaller

[mm] in
Knife Switch Termination Assemblies (Continued)

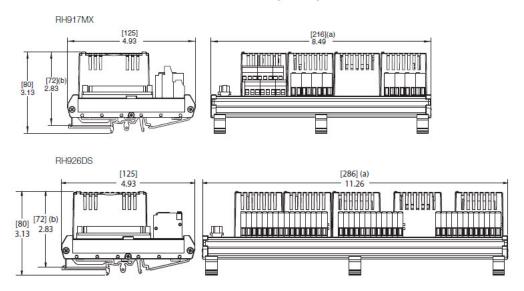

- (a) Overall width for determining DIN rail loading.
- (b) Height above DIN rail (add to DIN rail height for total)

General Purpose Plug-in Relay Termination Assembly Specifications

Description	SPDT, plug-in, field replaceable
Rated Load ^(a)	 dc Resistive: 5 A at 30 VDC dc Inductive (L/R = 7 MS): 5 A at 30 VDC ac Resistive: 5 A at 240 VAC ac Inductive (P.F. = 0.4): 5 A at 240 VAC
Carry Current(a)	5 A
Maximum Operating Voltage	240 VAC, 30 VDC(b)
Maximum Operating Current	5 A
Maximum Switching Capacity ^(a)	1200 VA, 150 W
Minimum Permissible Load	100 mA, 5 VDC
Contact Material	AgCdO
Contact Resistance	30 m Ω maximum
Life Expectancy	 Mechanical: 20 X 10⁶ operations minimum Electrical: 100 X10³ (at rated load)
Response Time	Operate: 15 ms maximum Release: AC: 10 ms maximum DC: 5 ms maximum

⁽a) The manufacturer's rated load is derated; the Termination Assembly maximum rated load is 5 A at 240 VAC/5 A at 30 VDC per channel, or 12 A maximum per group of eight outputs.

⁽b) The relay load must be derated at higher dc voltages.

Related Documents

Document Number	Description
B0400FA	Standard and Compact 200 Series Subsystem User's Guide
PSS 41H-2COV	Compact 200 Series I/O Subsystem Overview
PSS 41H-2C200	Compact 200 Series 16-Slot Horizontal Baseplate
PSS 41H-2SOV	Standard 200 Series Subsystem Overview
PSS 41H-2CERTS	Standard and Compact 200 Series I/O - Agency Certifications
PSS 41H-2C480	Compact Power Supply - FPS480-24
PSS 41S-3FCPICS	Field Control Processor 280 (FCP280) Integrated Control Software